

T755H

P.O. Box 3377

Springfield, MO 65808-3377 Toll Free: 888-776-1427 Web: www.pro1iaq.com

Hours of Operation: M-F 9AM - 6PM Eastern

Thermostat Application Guide

Description	
Gas or Oil Heat	Yes
Electric Furnace	Yes
Heat Pump (No Aux. or Emergency Heat)	Yes
Heat Pump (With Aux. or Emergency Heat)	Yes
Multi-Stage Systems	Yes
Heat Only Systems	Yes
Cool Only Systems	Yes
Millivolt	Yes
Any HVAC system up to 3H/2C with standard low voltage controlled humidifier.	Yes
Any HVAC system up to 3H/2C with standard low voltage controlled de-humidifier.	Yes

Table of Contents	Page
Installation Tips Thermostat Quick Reference Wiring Wiring Diagrams Technician Setup Setting the Humidity Programming Thermostat Features Specifications	2-3 4-5 6 7-10 11-16 17-18 19-21 22 23

Power Type

Battery Power Hardwire (Common Wire) Hardwire (Common Wire) with Battery Backup


A trained, experienced technician must install this product.

Carefully read these instructions. You could damage this product or cause a hazardous condition if you fail to follow these instructions.

Una version en español de este manual se puede descargar en la pagina web de la compañia.

Wall Locations

The thermostat should be installed approximately 4 to 5 feet above the floor. Select an area with average temperature and good air circulation.



Installation Tip


Pick an installation location that is easy for the user to access. The temperature of the location should be representative of the building.

Do not install thermostat in locations:

- Close to hot or cold air ducts
- That are in direct sunlight
- With an outside wall behind the thermostat
- In areas that do not require conditioning
- Where there are dead spots or drafts
- (in corners or behind doors)
- Where there might be concealed chimneys or pipes

Subbase Installation

- 1 Horizontal Mount
- ② Vertical Mount



For vertical mount put one screw on the top and one screw on the bottom. For horizontal mount put one screw on the

left and one screw on the right.

Installation Tip: **Electrical Hazard**

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.



Mercury Notice

All of our products are mercury free. However, if the product you are replacing contains mercury, dispose of it properly. Your local waste management authority can give you instructions on recycling and proper disposal.

2

Rev. 1845


Installation Tips

Mount Thermostat

Align the 4 tabs on the subbase with corresponding slots on the back of the thermostat, then push gently until the thermostat snaps in place.

® U.S. Registered Trademark. Patents pending

Copyright © 2018 All Rights Reserved.




Battery Installation

Battery installation is recommended even if thermostat is hardwired (C terminal connected). When thermostat is hardwired and batteries are installed, the thermostat will activate a compressor delay of 5 minutes when the thermostat detects a power outage from the hardwired power supply.



Important:


High quality alkaline batteries are recommended. Rechargeable batteries or low quality batteries do not guarantee a 1-year life span.

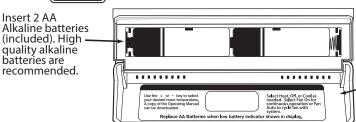

Simple operating instructions are found on the back of the battery

Thermostat Quick Reference

Getting to know your thermostat

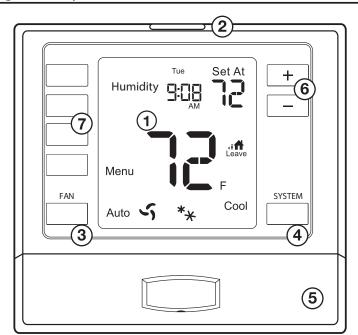

- (1) LCD Display
- **2**) Glow in the dark light button
- **3**) Fan Button
- **4**) System Button
- (5) Easy change battery door
- (6) Temperature Setpoint Buttons
- **User Buttons**

Wiring

terminal.

block screws.

1. If you are replacing a thermostat, make note of the terminal

connections on the thermostat that is being replaced. In some cases the wiring connections will not be color coded. For example, the green

wire may not be connected to the G

Insert wires then retighten terminal


3. Place nonflammable insulation into

wall opening to prevent drafts.

2. Loosen the terminal block screws.

Wiring

Getting to know your thermostat



- (1) Indicates the current room temperature
- (2) Time and day of the week
- (3) Low Battery Indicator: Replace batteries when this indicator is shown.
- (4) Menu Options: Shows different options.
- (5) **Program Time Periods:** This thermostat has 4 programmable time periods per day.
- System Operation Indicators:
 The COOL ON ***, HEAT ON \$\display\$ or \$\display\$ icon will display when the COOL, HEAT, or \$\display\$ (fan) is on. The compressor delay feature is active if these are flashing.
- (7) **Hold** is displayed when the thermostat program is permanently overridden.
- 8 **Setpoint:** Displays the selected setpoint temperature.
- (9) **System:** Indicates current mode of operation.
- (10) **Stages:** +1 will appear in the display when second stage of heat or cool is on. +2 will appear for third stage of heat.

Important

The low battery indicator is displayed when the AA battery power is low. If the user fails to replace the battery within 21 days, the screen will only show the low battery indicator but maintain all functionality. If the user fails to replace the batteries after an additional 21 days (days 22-42 since first "low battery" display) the setpoints will change to 55°F (Heating) and 85°F (Cooling). If the user adjusts the setpoint away from either of these, it will hold for 4 hours then return to either 55°F or 85°F. After day 63 the batteries must be replaced immediately to avoid freezing or overheating because the thermostat will shut the unit off until the batteries are changed.

Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.



Warning:


All components of the control system and the thermostat installation must conform to Class II circuits per the NEC Code.

Terminal	2 Heat 2 Cool Conventional System	2 Heat 2 Cool Heat Pump System	3 Heat 2 Cool Heat Pump System
RC	Transformer power (cooling)	Transformer power (cooling)	Transformer power (cooling)
RH	Transformer power (heating)	Transformer power (heating)	Transformer power (heating)
С	Transformer common	Transformer common	Transformer common
В	Energized in heating	Heat pump changeover valve energized in heating	Heat pump changeover valve energized in heating
0	Energized in cooling	Heat pump changeover valve energized in cooling	Heat pump changeover valve energized in cooling
G	Fan relay	Fan relay	Fan relay
W/E	First stage of heat	First stage of emergency heat	First stage of emergency heat
W2	Second stage of heat	Auxiliary heat relay, second stage of heat	Auxiliary heat relay, third stage of heat
Υ	First stage of cool	First stage of heat & cool	First stage of heat & cool
Y2	Second stage of cool	Second stage of cool	Second stage of cool & second stage of heat
Н	Humidify	Humidify	Humidify
D	Dehumidify	Dehumidify	Dehumidify


6

Wiring Diagrams


Typical 2H/2C system with 24 VAC Humidifier



Typical 2H/2C system with Dehumidify Terminal



Typical 2H/2C system with Dry Contact Humidifier

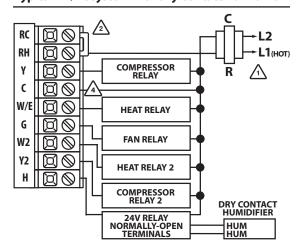



Note: In many heat pump systems with no emergency heat relay a jumper can be installed between E and W2.

Wiring Tips

C Terminal

The C (common wire) terminal does not have to be connected when the thermostat is powered by batteries.

Wire Specifications

Use shielded or non-shielded 18-22 gauge thermostat wire.



Installation Tip: Do not overtighten terminal block screws, as this can damage the terminal block. A damaged terminal block can keep the thermostat from fitting on the subbase correctly or cause system operation issues. **Max Torque = 6in-lbs.**



 $\stackrel{\textstyle \checkmark}{2}$ Factory - installed jumper. Remove only when installing on 2 transformer systems.




Optional 24 VAC common connection when thermostat is used in battery power mode.




If DEHUM relay requires a normally-energized input, set Dehumidify relay to NC in Technician Setup.


Typical 2H/2C System: 1 Transformer



Typical 2H/2C System: 2 Transformer

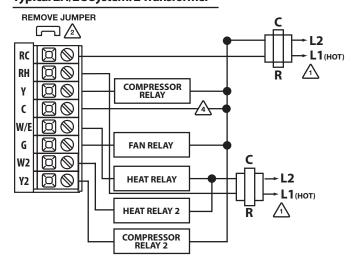

Typical 3H/2C or 2H/1C Heat Pump System

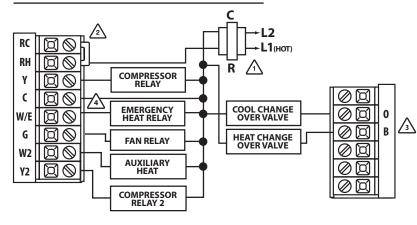

7

Tech Settings

Technician Setup Menu

This thermostat has a technician setup menu for easy installer configuration. To setup the thermostat for your particular application:

- 1. Press the **MENU** button
- 2. Press and hold **TECH SET** button for 3 seconds. This 3 second delay is designed so that homeowners do not accidentally access the installer settings.
- 3. Configure the installer options as desired using the table below.

Use the ____ keys to change settings and the **NEXT STEP** or **PREV STEP** key to move from one step to another. **Note:** Only press the **DONE** key when you want to exit the Technician Setup options.

the DONE key when you want to exit the rechnician setup options.						
Tech Setting	gs	LCD Will Show	Adjustment Options	Default		
Filter Change Reminder	This feature will flash "FILT" in the display after the elapsed run time to remind the user to change the filter. A setting of "OFF" will disable this feature.	Next OFF SE	You can adjust the filter change reminder from OFF to 2000 hours of runtime in 50 hour increments. Tap the second button from the top left side of the thermostat to display the current filter elapsed runtime.	OFF		
Room Temperature Calibration	This feature allows the installer to change the calibration of the room temperature display. For example, if the thermostat reads 70° degrees and you would like it to read 72° then select +2.	Prev Done	You can adjust the room temperature display to read 4° above or below the factory calibrated reading.	0		
Minimum Compressor On Time	This feature allows the installer to select the minimum run time for the compressor. For example, a setting of 4 will force the compressor to run for at least 4 minutes everytime the compressor turns on, regardless of the room temperature.	Next COMN OF Prev Done	You can select the minimum compressor run time from "off", "3", "4", or "5" minutes. If 3, 4, or 5 is selected, the compressor will run for at least the selected time before turning off.	OFF		
Compressor Short Cycle Delay	The compressor short cycle delay protects the compressor from short cycling. This feature will not allow the compressor to be turned on for 5 minutes after it was last turned off.	Next COdY [][] Prev Done	Selecting ON will not allow the compressor to be turned on for 5 minutes after the last time the compressor was switched off. Select OFF to remove this delay.	ON		

Tech Settings

Tech Setti	ngs	LCD Will Show	Adjustment Options	Default
Cooling Swing	The swing setting often called "cycle rate", "differential" or "anticipation" is adjustable. A smaller swing setting will cause more frequent cycles and a larger swing setting will cause fewer cycles.	Next dFC0	The cooling swing setting is adjustable from 0.2° to 2°. For example: A swing setting of 0.5° will turn the cooling on at approximately 0.5° above the setpoint and turn the cooling off at approximately 0.5° below the setpoint.	0.5
Heating Swing	The swing setting often called "cycle rate", "differential" or "anticipation" is adjustable. A smaller swing setting will cause more frequent cycles and a larger swing setting will cause fewer cycles.	Next dFHE Prev Done	The heating swing setting is adjustable from 0.2° to 2°. For example: A swing setting of 0.5° will turn the heating on at approximately 0.5° below the setpoint and turn the heating off at approximately 0.5° above the setpoint.	0.4
Heating Setpoint Limit	This feature allows you to set a maximum heat setpoint value. The setpoint temperature cannot be raised above this value.	HELM 98	Use the + and - key to select the maximum heat setpoint.	90
Cooling Setpoint Limit	This feature allows you to set a minimum cool setpoint value. The setpoint temperature cannot be lowered below this value.	COLM -{-{-	Use the 🛨 and 🖃 key to select the minimum cool setpoint.	44
Morning Recovery	This feature will start heating early to bring the building temperature to its programmed setpoint by the begining of the WAKE time period.	Next MORN OFF	Use the	ON
For C	Select F for Fahenheit temperature read out or select C for Celsius read out.	Prev Done	F for Fahrenheit C for Celsius	F

Swing Setting Tip

Temperature swing, sometimes called differential or cycle rate, can be customized for this individual application. For most applications choose a swing setting that is as long as possible without making the occupants uncomfortable.

Tech Settings

Tech Setti	ngs	LCD Will Show	Adjustment Options	Default
12 or 24 Hour Clock	You can select either a 12 or 24 hour clock setting.	Next ELOK 2 Prev Done	Use the → and → to select 12 or 24 hour clock.	12
Fan Operation	Select GAS for systems that control the fan during a call for heat. Select ELEC to have the thermostat control the fan during a call for heat.	Next FRN GR Prev Done	GAS - GS or ELEC - EL	GAS
Program Options	You can configure this thermostat to have 7 Days, 5+1+1 program- ming or non programmable.	Prev Done	Use the 🛨 and 🖃 key to select 7d for 7 Day, 5d for 5+1+1, or 0d for non programmable.	5d
Heat Pump	When turned on the thermostat will operate a heat pump. 1. EM. Heat will show as an option in the system switch. 2. Y will be first stage of heat & cool, W/E will be emergency heat relay & W2 will be axiliary heat relay.	HPUM DF Prev Done	OFF configures the thermostat for non-heat pump systems. ON configures the thermostat for heat pump systems.	OFF
System Switch	You can configure the system switch for the particular application: Heat - Off - Cool, Heat - Off, Cool - Off. Note: EM. Heat will show if in heat pump mode.	Next SYST Prev Done Cool Heat Off	Use the	Heat Off Cool
Dual Fuel Auxiliary for Heat Pump Will only appear if Heat pump setting is turned ON.	For Dual Fuel applications (Gas/Fossil fuel Auxiliary Heat), turn this setting ON to LOCKOUT the Heat Pump (Y) when Auxiliary Heat (W2) is on. If desired - This can also be used with Electric Auxiliary.	GAUX DF Prev Done	OFF Will allow Y(1st stage of Heat) and W2 (Aux Heat) to run together if called for. ON Will de-energize Y terminal 45 seconds after a call for Auxiliary Heat (W2).	OFF

Tech Settings

Tech Setti	ngs	LCD Will Show	Adjustment Options	Default
Stages of Heat	You can configure the thermostat to operate a 3 stage heat pump system. 2H 2C = 2 heat, 2 cool 3H 2C = 3 heat, 2 cool This feature only shows if Technician Setup Step for HEAT PUMP is set to ON.	Next Step HPUM 2H Prev Step	Use the or key to change between 2H and 3H. 2H will use Y1 as first stage and W2 as auxiliary. 3H will use Y1 as first stage, Y2 as second stage and W2 as auxiliary.	2H
Cooling Fan Delay	The cooling fan delay setting will delay the fan from coming on in cool mode and keep running after the compressor shuts off for a short time to save energy in some systems.	Next Step FNdL OF Prev Step	You can select the cooling fan delay from "OFF", "15", "30", "60" or "90" seconds. If 15, 30, 60 or 90 is selected the fan will not turn on for that many seconds when there is a call for cool and will run for that many seconds after satisfying a call for cool.	OFF
Humidify	This feature adds humidity when system key is in HEAT. Note: See terminal Options on page 15.	Next HUMd DF Prev Done	Use the 🛨 and 🖃 key to turn on or off. If ON is selected the humidity will be displayed on the main screen and HUM terminal will energize when humidity setpoint is above ambient humidity in Heat mode.	OFF
Dehumidify	This feature removes humidity when system key is in COOL. Note: See terminal Options on page 15.	Next HUM OF Prev Done	Use the 🛨 and 🖃 key to turn on or off. If ON is selected the humidity will be displayed on the main screen and DUM terminal will energize when humidity setpoint is below ambient humidity in Cool mode.	OFF
Humidity Calibration	This feature allows the installer to change the callibration of the ambient humidity displayed.	Next HERL Prev Done	Use the 🛨 and 🖃 key to adjust the calibration +/-3. Each one unit of adjustment amounts to approximately 5%.	0
Dehumidify with AC	This feature forces the A/C to run longer to remove humidity when needed. The A/C will "over cool" the room a few degrees until humidity reaches the desired setpoint.	HAL TO	Use the + and - key to select YES or NO. If selected YES allows over cooling to be used to control humidity in Cool mode. If NO is selected the system will not use over cooling.	NO

B

1

Setting the Humidity

Setting Target Humidity Setpoint

Follow the steps below to change your target humidity setpoint.

Press the **HUMIDITY** key

Use the + or - key to select the target humidity setpoint. Press **DONE** when completed.

Note:



The target humidity setpoint is not programmable. Unlike temperature, humidity does not change quickly and should not be programmed.

Humidity is only energized during heat. Dehumidify is only energized during cool. Heat and Cool each have their own target setpoints.

Setting the Humidity

Setting Target Humidity Setpoint

Ambient humidity will flash in the time field when Humidify or De-Humidify is set to **ON.**

HON will also flash when the Humidity terminal is energized. **dON** will also flash when the De-Humidify terminal is energized.









DAY AND TIME

AMBIENT HUMIDITY

HON (Humidity Energized)

dON (De-Humidity Energized)

Recommended Heating Settings:

Increasing Humidity


The table on the right shows recommended indoor humidity levels in relation to outdoor temperatures during heating (adding humidity).

Recommended Cooling Settings:

Consult your professional HVAC technician for recommended settings for your climate.

Recommended Relative Humidity
35% to 40%
30%
25%
20%
15%





Tech Settings

Tech Setti	ngs	LCD Will Show	Adjustment Options	Default
Over Cool Limit	The amount of over cooling allowed when using A/C to remove humidity. This screen is only shown when ON is selected in the Dehumidify with AC tech setup step.	Next OCOL 3 Prev Done	Use the 🛨 and 🖃 key to select the maximum number of degrees of over cool. Options are: 2,3,4,5	3
HUM Terminal	Options for how the HUM terminal energizes. See chart below	Next Step HTRM	Use the	1
DHM Terminal	Option for how the DUM terminal energizes. See chart below	Next Step dTHM Prev Step	Use the	1
Dehumidify Relay	You can configure the D terminal as Normally-Open or Normally-Closed. NO = Normally Open NC = Normally Closed	Next Step dHR	Use the	NO

HUM Terminal

HUM Terminal DHM		DHM	Terminal	
OPTIONS	HUM terminal energizes when the ambient humidity is		OPTIONS	DUM terminal energizes when the ambient humidity is
1	Below the humidity setpoint and heat or fan is energized.		1	Above the humidity setpoint and cool or fan is energized.
2	Below the humidity setpoint and heat is energized.		2	Above the humidity setpoint. It will also energize the fan during a call for dehumidity.
3	Below the humidity setpoint. It will also energize the fan during a call for humidity.		3	Above the humidity setpoint.
4	Below the humidity setpoint.		4	Above the humidity setpoint and the compressor is not running.

Tech Settings

Tech Setti	ngs	LCD Will Show	Adjustment Options	Default
Satisfy Setpoint	This feature allows the thermostat to keep multiple stages of heat or cool energized until setpoint is satisfied for that cycle.	Next Step S ST DF Prev Step	Use the 🛨 or 🖃 key to turn ON or OFF.	OFF
Staging Delay	This feature allows a delay to occur when a second stage is needed. This allows the previous stage extra time to satisfy setpoint.	Next Step 5d	Use the 🛨 or 🖃 key to select OFF, 10, 15, 30, 45, 60, or 90 minutes.	OFF



Note: Our standard staging logic, optional satisfy setpoint and optional staging delay allows for job by job customization that balances comfort, energy efficiency and equipment longevity.

Programming

Programming

All of our programmable thermostats are shipped with an energy saving pre-program. You can customize this default program by following the steps on next page.

There are four time periods for each program (WAKE, LEAVE, RETURN, SLEEP).

Factory Default Program					
Day of the Week	Events	Time	Setpoint Temperature (HEAT)	Setpoint Temperature (COOL)	
	Wake	6 AM	70°F (21°C)	75°F (24°C)	
Wookday	Leave	8 AM	62°F (17°C)	83°F (28°C)	
Weekday	Return	6 PM	70°F (21°C)	75°F (24°C)	
	Sleep	10 PM	62°F (17°C)	78°F (26°C)	
	Wake	6 AM	70°F (21°C)	75°F (24°C)	
Saturday	Leave	8 AM	62°F (17°C)	83°F (28°C)	
Saturday	Return	6 PM	70°F (21°C)	75°F (24°C)	
	Sleep	10 PM	62°F (17°C)	78°F (26°C)	
	Wake	6 AM	70°F (21°C)	75°F (24°C)	
Sunday	Leave	8 AM	62°F (17°C)	83°F (28°C)	
Juliuay	Return	6 PM	70°F (21°C)	75°F (24°C)	
	Sleep	10 PM	62°F (17°C)	78°F (26°C)	

Programming

Set Program Schedule 5+1+1 or 7 Day

To customize your program schedule, follow these steps:

- 1. Select **HEAT** or **COOL** with the system switch. **Note:** You have to program heat and cool each seperately.
- 2. Press the MENU button (If menu does not appear first press RUN SCHED)
- 3. Press SET SCHED. Note: Monday-Friday or (Monday if in 7 Day) is displayed and the **WAKE** icon is shown. You are now programming the wake time period for that day.
- **4.** Time is flashing. Use the + or key to make your time selection for that day's **WAKE** time period. Note: If you want the fan to run continuously during this time period, select **ON** with the **FAN** key.
- 5. Press NEXT STEP
- **6.** The setpoint temperature is flashing. Use the + or key to make your setpoint selection for that day's WAKE time period.
- 7. Press NEXT STEP
- 8. Repeat steps 4 thru 7 for that day's **LEAVE** time period, **RETURN** time period, and **SLEEP** time period.



If in 5+1+1 Programming:

Repeat steps 4 thru 8 for the Saturday + Sunday time periods.

If using 7- Day Programming:

Use these same steps for every individual day.

Programming

Set Time (If using programming)

1. With system switch set to OFF, press the **MENU** button

2. Press SET TIME

3. Day of the week will be flashing. Use the to select the current day of the week.

4. Press NEXT STEP

5. The current hour is flashing. Use the ____ key to select the current hour. When using 12-hour time, make sure the correct a.m. or p.m. choice is selected.

6. Press NEXT STEP

7. Minutes are now flashing. Use the + or - key to select current minutes.

8. Press **DONE** when completed.

Features

Temporary and Permanent Hold Feature (If using programming)

When cool or heat is turned on, the thermostat will display **HOLD** and **RUN SCHED** on the left of your screen when you press the + or - button.

Temporary Hold: At this time if you do nothing, the temperature will remain at this setpoint temporarily for 4 hours.

Permanent Hold: If you press the **HOLD** key on the left of your screen, you will see **HOLD** appear below the setpoint temperature in the display. The thermostat will now permanently stay at this setpoint and can be adjusted using the + or - keys.

To Return to Running Schedule: Press the **RUN SCHED** button on the left of your screen to exit either temporary or permanent hold.


Filter Change Reminder

If your installing contractor has configured the thermostat to remind you when the air filter needs to be changed, you will see **FILT** in the display when your air filter needs to be changed.

Resetting the filter change reminder: When **FILT** reminder is displayed, you should change your air filter and reset the reminder by holding down the second button from the top left side of the thermostat for 3 seconds.

About The Private Label Badge

All of our thermostats use the same universal magnetic badge. Visit the company website to learn more about our free private label program.



Gently slide a screwdriver into the bottom edge of the badge. Gently turn the screwdriver counter clockwise. The badge is held on by a magnet in the well of the battery door. The badge should pry off easily. **DO NOT USE FORCE.**



Specifications

Specifications